



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

## NOTICE OF ACCEPTANCE (NOA)

**MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION**

11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786)315-2590 F (786) 315-2599

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**Dr. Good Roof**  
**11461 Tamiami Trail**  
**Punta Gorda, FL 33955**

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

### DESCRIPTION: CeeTile Low Concrete Roof Tile

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA No. 08-0715.10 consists of pages 1 through 6.  
The submitted documentation was reviewed by Juan E. Collao, R.A.



**NOA No.: 13-0419.07**  
**Expiration Date: 08/22/18**  
**Approval Date: 08/22/13**  
**Page 1 of 6**

## ROOFING ASSEMBLY APPROVAL

**Category:** Roofing  
**Sub-Category:** Low Profile Roofing Tiles  
**Material:** Concrete  
**Deck Type:** Wood

### 1. SCOPE

This renews system using Dr. GoodRoof 'CeeTile' Concrete Roof Tile, as manufactured Dr. GoodRoof and described in Section 2 of this Notice of Acceptance. For locations where the pressure requirements, as determined by applicable Building Code does not exceed the design pressure values obtained by calculations in compliance with RAS 127 using the values listed in section 4 herein. The attachment calculations shall be done as a moment based system.

### 2. PRODUCT DESCRIPTION

<u>Manufactured by Applicant</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
GOODTILE	l = 16.5" w = 13" ½" thick	TAS 112	Low profile, interlocking, concrete roof tile equipped with three nail holes. For direct deck, mortar or adhesive set applications.
Trim Pieces	l = varies w = varies varying thickness	TAS 112	Accessory trim, concrete roof pieces for use at hips, rakes, ridges and valley terminations. Manufactured for each tile profile.

### 2.1. MANUFACTURING LOCATION

2.1.1. Punta Gorda, FL

### 2.2. EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Asphalt Technologies, Inc.	DGR-001-02-01	TAS 100	03/13/01
	DGR-007-02-01	TAS 112	03/13/03
	DGR-057-02-01	TAS 112	06/09/08
	DGR-117-02-01	TAS 112	07/24/13
Celotex Corporation Testing Services	528454-2-1	Static Uplift Testing	Sep. 1998
	520109-2	PA 101	Dec. 1998
The Center for Applied Engineering, Inc.	25-7183-(1, 2 & 7)	Static Uplift Testing TAS 102	Feb. 1995
	25-7214-(2 & 6)		March, 1995
	25-7487-1		Dec. 1995
	25-7496-(2 & 3)		Dec. 1995
	25-7804-5		Sep. 1996
Walker Engineering, Inc.		Aerodynamic Multiplier	02/25/03

### 3. LIMITATIONS

- 3.1 Fire classification is not part of this acceptance.
- 3.2 For mortar or adhesive set tile applications, a static field uplift test in accordance with TAS 106 may be required, refer to applicable building code.
- 3.3 Applicant shall retain the services of a Miami-Dade County Certified Laboratory to perform quarterly test in accordance with TAS 112, appendix 'A'. Such testing shall be submitted to the Miami-Dade Product Control Office for review.
- 3.4 Minimum underlayment shall be in compliance with the applicable Roofing Applications Standards listed section 4.1 herein.
- 3.5 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- 3.6 This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable building code.
- 3.7 All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9N-3 of the Florida Administrative Code.

### 4. INSTALLATION

- 4.1 Dr. Goodroof 'CeeTile' Concrete Roof Tile and its components shall be installed in strict compliance with Roofing Application Standard RAS 118, RAS 119, and RAS 120.
- 4.2 Data For Attachment Calculations

**Table 1: Average Weight (W) and Dimensions (l x w)**

Tile Profile	Weight-W (lbf)	Length - l (feet)	Width-w (feet)
CEETILE	11.0	1.375	1.08

**Table 2: Aerodynamic Multipliers -  $\lambda$  (ft<sup>3</sup>)**

Tile Profile	$\lambda$ (ft <sup>3</sup> )	
	Direct Deck Application	Batten Application
CEETILE	0.289	0.266

**Table 3: Restoring Moments due to Gravity -  $M_g$  (ft-lbf)**

Tile Profile	3":12"		4":12"		5":12"		6":12"		7":12" or greater	
	Battens	Direct Deck	Battens	Direct Deck	Battens	Direct Deck	Battens	Direct Deck	Battens	Direct Deck
CEETILE	7.04	7.74	6.93	7.62	6.79	7.45	6.62	7.29	6.44	N/A

**Table 4: Attachment Resistance Expressed as a Moment -  $M_f$  (ft-lbf)  
For Nail-On Systems**

Tile Profile	Fastener Type	Direct Deck (Min $1\frac{5}{32}$ " plywood)	Direct Deck (Min. $1\frac{9}{32}$ " plywood)	Battens
CEETILE	2-10d Ring Shank Nails	27.8	37.4	28.8
	1-10d Smooth or Screw Shank Nail	8.8	11.8	4.1
	2-10d Smooth or Screw Shank Nails	16.4	21.9	7.1
	1 #8 Screw	25.8	25.8	22.9
	2 #8 Screw	47.1	47.1	49.1
	1-10d Smooth or Screw Shank Nail (Field Clip)	24.3	24.3	24.2
	1-10d Smooth or Screw Shank Nail (Eave Clip)	19.0	19.0	22.1
	2-10d Smooth or Screw Shank Nails (Field Clip)	35.5	35.5	34.8
	2-10d Smooth or Screw Shank Nails (Eave Clip)	31.9	31.9	32.2
	2-10d Ring Shank Nails <sup>1</sup>	43.0	67.5	50.9

<sup>1</sup> Installation with a 4" tile headlap and fasteners are located a min. of 2½" from head of tile.

**Table 5: Attachment Resistance Expressed as a Moment  $M_f$  (ft-lbf)  
For Two Patty Adhesive Set Systems**

Tile Profile	Tile Application	Minimum Attachment Resistance
CEETILE	Adhesive	26.1 <sup>3</sup>

<sup>2</sup> See manufacturer component approval for installation requirements.

<sup>3</sup> Flexible Products Company TileBond Average weight per patty 11.4 grams.

3M™ 2-Component Foam Roof Tile Adhesive AH-160 Average weight per patty 8 grams.

**Table 5A: Attachment Resistance Expressed as a Moment -  $M_f$  (ft-lbf)  
For Single Patty Adhesive Set Systems**

Tile Profile	Tile Application	Minimum Attachment Resistance
CEETILE	3M™ 2-Component Foam Roof Tile Adhesive AH-160	86.61 <sup>4</sup>
	3M™ 2-Component Foam Roof Tile Adhesive AH-160	45.5 <sup>5</sup>

<sup>4</sup> Large paddy placement of 54 grams of 3M™ 2-Component Foam Roof Tile Adhesive AH-160

<sup>5</sup> Medium paddy placement of 24 grams of 3M™ 2-Component Foam Roof Tile Adhesive AH-160

**Table 4B: Attachment Resistance Expressed as a Moment -  $M_f$  (ft-lbf)  
For Mortar Set Systems**

Tile Profile	Tile Application	Attachment Resistance
CEETILE	Mortar Set <sup>1</sup>	20.60

## **5. LABELING**

All tiles shall bear the imprint or identifiable marking of the manufacturer's name or logo as seen below or following statement: "Miami-Dade County Product Control Approved".

# **CEETILE**

**CEETILE TILE LABEL  
(LOCATED UNDERNEATH OF TILE)**

## **6. BUILDING PERMIT REQUIREMENTS:**


**6.1** Application for building permit shall be accompanied by copies of the following:

**6.1.1** This Notice of Acceptance.

**6.1.2** Any other documents required by Building Official or Applicable building code in order to properly evaluate the installation of this system.



## PROFILE DRAWINGS

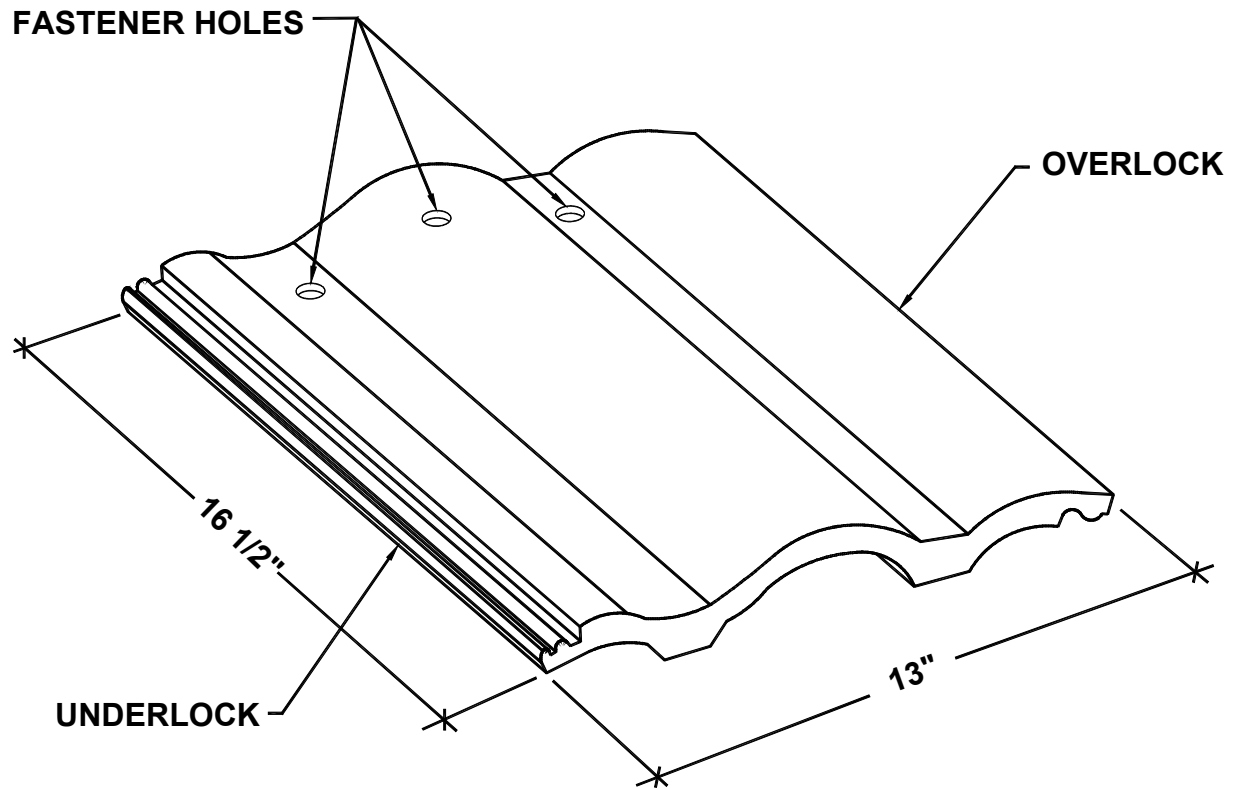

**DR. GOOD ROOF "CEE TILE" CONCRETE ROOF TILE**

**END OF THIS ACCEPTANCE**